



Plastic Pipe and Fittings Association

PUBLICATIONS | CPVC Specification Sheet

CHLORINATED POLYVINYL CHLORIDE (CPVC):

Plastic Piping and Fitting Systems for Hot- and Cold- Water Distribution

Published by the
Plastic Pipe and Fittings Association (PPFA)
800 Roosevelt Road
Building C, Suite 312
Glen Ellyn, IL 60137
www.ppfahome.org

PPFA-22-25
December 2025, Version 2

1. PRODUCT NAME

Chlorinated Polyvinyl Chloride (CPVC) Plastic Pipe and Fittings for Hot- and Cold-Water Distribution Systems.

2. MANUFACTURERS

To get a list of member manufacturers, visit our website at: <https://www.ppfahome.org/page/cpvc>.

3. PRODUCT DESCRIPTION

Basic Use:

Hot- and cold-water distribution systems, including water recirculation lines. CPVC pipe can be used in residential, commercial, and industrial applications. CPVC CTS SDR 11 pipe and fittings are used in the systems described.

Pipe and fittings are typically joined by solvent cementing or mechanical fittings. Connections between CPVC pipe and other piping materials are accomplished by use of adapter fittings. These fittings utilize threaded joints, compression connections, flanges, or mechanical connections.

Composition and Materials:

CPVC is a thermoplastic material, and the CPVC compounds meet the requirements of Class 23447 as referenced in ASTM D1784.

Grades and Sizes:

CPVC pipe and fittings are available in Copper Tube Size (CTS) 1/2 through 2 inches and in Iron Pipe Size (IPS) 1/4 through 24 inches. CPVC IPS pipe is available as Schedules 40 and 80 or SDR-PR pipe. The CTS pipe has the same outside diameter as copper tube. The IPS pipes have the same outside diameter as the corresponding sizes of steel pipe. CTS is available in sizes 1/2 through 2 inches. For installations larger than 2 inches, Schedules 40 and 80, and SDR-PR pipe are available in sizes up to 12 inches.

Limitations:

SDR 11 CTS CPVC pipe and fittings are pressure-rated for continuous use at 400 psi at 73.4°F and 100 psi at 180°F. Each size of the Schedules 40 and 80 pipe have a different pressure rating and as the temperature increases, the pressure rating decreases. Consult the tables in ASTM F441 for full details. Under no circumstances should the temperature exceed 180°F for pressure piping.

Plastics are affected by ultraviolet radiation. Pigments are added to the CPVC materials to shield them from radiation effects. CPVC piping can be exposed to sunlight during construction; however, prolonged exposure to the sun is not advised unless protected by a light colored water-based latex paint.

4. TECHNICAL DATA

Applicable Standards:

ASTM D2846 or CSA CAN/CSA B137.6 apply to CPVC SDR 11 (CTS) pipe and fittings. ASTM F441 applies to Schedules 40 and 80 pipe. ASTM F442 applies to SDR-PR pipe. ASTM F438 applies to Schedules 40 socket fittings. ASTM F3328 and F493 applies to solvent cements for CPVC.

Quality Control:

Most pipe and fittings are evaluated and listed by an ANSI-accredited third party listing agency (e.g., NSF, IAMPO, R&T, CSA, ICC-ES or UL). These agencies certify CPVC piping as conforming with NSF/ANSI-14 and NSF/ANSI/CAN-61 for use in potable water systems and for strength and durability requirements. Contact the manufacturer for more information.

Chemical Resistance:

CPVC pipe and fittings are resistant to chemicals used in disinfecting potable water. CPVC pipe resists certain chemical actions on the exterior of the pipe when located in hazardous environments. Contact the manufacturer for a detailed list of chemicals CPVC pipe can resist.

Flow Characteristics:

CPVC pipe does not corrode or accumulate mineral deposits. CPVC pipe should be designed with a water flow rate between 8 feet per second ([shown in Table 1](#)). Water velocities in excess of 5 feet per second are not recommended for large diameter (greater than 6 inches) IPS CPVC systems.

Friction loss for flow through fittings is based on the equivalent length of pipe. Equivalent lengths of pipe for CTS fittings 1/2 inch through 2 inches are shown in [Table 2](#). Consult the manufacturer's published tables for dimensions, friction loss data, and equivalent length of pipe for IPS Schedules 40 and 80 fittings.

Water Hammer:

The intensity of water hammer in CPVC pipe is approximately 1/3 the intensity of copper or steel pipe.

Laying Lengths:

CPVC pipe is available in 10 and 20 foot lengths. The smaller sizes (1 inch max.) of CPVC CTS are also available in coils. Minimum laying lengths for CPVC SDR 11 (CTS) fittings are identified in [Table 3](#).

Expansion and Contraction:

CPVC pipe has a higher coefficient of expansion and contraction than metallic pipe. The coefficient of linear expansion for CPVC plastic is 0.000034 in/in/°F. This translates into an expansion of 2.04 inches for every 50 feet with a temperature change of 100°F.

Where CPVC pipe is installed in long straight lengths, compensation for expansion and contraction must be provided. This can be accomplished at changes in direction or with offset piping arrangements such as loops or bends so that pipe flexibility provides for thermal expansion.

Hangers and Supports:

CPVC pipe must be supported at 3 foot intervals for pipe 1 inch and less in diameter and 4 foot intervals for pipe 1 1/4 to 2 inches. For larger sizes of Schedules 40 and 80 pipe, consult the tables that show support spacing as a function of both size and temperature.

Vertical pipe shall be supported at each floor level with mid-story guides. Where the design engineer has made provisions for expansion they must be followed. Install hangers and supports to allow for thermal expansion and contraction. Avoid the use of hangers and supports that contain chemicals that are known as plasticizers.

Fire Rated Penetrations:

CPVC pipe and fittings may be used in residential, commercial, and industrial buildings, even those that require non-combustible construction.

Through penetrations of fire-resistance-rated assemblies, CPVC pipe is accepted in the model building codes when such assemblies have successfully met the requirements of ASTM E814. These penetration assemblies are listed by ANSI accredited testing agencies such as UL and Intertek. Verify local code interpretations related to through penetrations with the jurisdiction having authority. Refer to the local building department for regulations concerning use of CPVC pipe and fittings.

Flame Spread and Smoke Developed Rating:

When tested in an ASTM E84 tunnel, water-filled CPVC pipe (2 1/2 inches and smaller) had a flame spread of 25 or less and smoke-developed rating of 50 or less. Contact pipe manufacturers for additional information.

5. INSTALLATION

Preparatory Work:

All CPVC pipe must be cut square with a sharp tool: a wheeled tubing cutter or ratchet cutter for CTS, a miter saw, or a power saw designed for that use. Pipe ends must be deburred (inside and outside) and wiped clean and dry. The chamfer should be between 10 and 22 degrees.

Methods:

Solvent cementing of CPVC pipe and fittings requires joint preparation. The joint is made while the solvent cement is still wet. Follow the manufacturer's instructions for proper application and use of the CPVC solvent cements and as provided by the pipe and fitting

manufacturer printed on the container label. Check the local code for approval prior to use and follow the instructions on the can label.

When threaded adapter fittings are installed, apply joint tape or paste thread sealant that is specifically approved for use with CPVC to the male threads. Adapter fittings must be installed in accordance with the manufacturer's installation instructions.

Precautions for Joining With Solvent Cements:

Solvent cementing CPVC pipe and fittings should be performed in well-ventilated locations. Contact of primer and solvent cement with the skin should be avoided. Eye protection is recommended during solvent cementing. ***See ASTM F402 for more safe handling details.***

Protect pipe from contact with sharp objects or building materials such as nails and metal studs. Care must be exercised to avoid rough handling or abrasion of the pipe and fittings. CPVC pipe should not be installed in close proximity to high heat sources.

Plumbing Codes:

CPVC pipe is permitted to be used in hot- and cold-water distribution systems, without limitation, in the following model plumbing codes: IAPMO Uniform Plumbing Code, ICC International Plumbing Code, National Plumbing Code of Canada, and NSPC National Standard Plumbing Code.

Verify with the local code enforcement authorities having jurisdiction that CPVC piping is approved for hot- and cold-water distribution systems.

6. AVAILABILITY AND COST

Availability:

CPVC pipe and fittings are available through local plumbing and supply wholesalers, hardware stores, and farm and home centers throughout the United States and Canada.

Cost:

The cost of CPVC installed pipe is less than metallic piping materials used in hot- and cold-water distribution systems.

7. WARRANTY

CPVC pipe and fittings manufacturers generally warrant that their pipe and fittings are free from defects and conform to designated standards.

However, most warranties contain limitations such as, for example, they are only applicable to pipe and fittings installed following the manufacturer's installation instructions. ***Warranties should be read carefully. Pipe and fittings manufacturers are not responsible for improper use, handling, or installation of the product.***

8. MAINTENANCE

Normal maintenance as required.

9. TECHNICAL SERVICES

Manufacturers of CPVC pipe and fittings will provide technical manuals and engineering data upon request.

10. MORE INFORMATION

Additional product information is available upon request from the Plastic Pipe and Fittings Association (PPFA) at: <https://www.ppfahome.org/page/cpvc>.

TABLE 1:
FRICTIONAL LOSSES FOR CTS CPVC PIPE AT
DIFFERENT WATER VELOCITIES

VELOCITY (FPS)	FLOW (GPM)	½" CTS HEAD LOSS* (FEET) (PSI)		FLOW (GPM)	¾" CTS HEAD LOSS* (FEET) (PSI)		FLOW (GPM)	1" CTS HEAD LOSS* (FEET) (PSI)	
2	1.14	4.28	1.86	2.47	2.78	1.20	4.11	2.07	0.90
4	2.29	15.56	6.75	4.94	10.02	4.34	8.22	7.47	3.24
5	2.87	23.64	10.25	6.17	15.12	6.55	10.27	11.28	4.89
6	3.44	33.07	14.34	7.40	21.18	9.18	12.32	15.81	6.85
8	4.59	56.41	24.45	9.87	36.10	15.65	16.43	26.94	11.68
10	5.74	85.35	37.00	12.34	54.49	23.66	20.54	40.73	17.66
12	6.89	119.77	51.92	14.81	76.58	24.65	24.65	57.27	24.83
VELOCITY (FPS)	FLOW (GPM)	1¼" CTS HEAD LOSS* (FEET) (PSI)		FLOW (GPM)	1½" CTS HEAD LOSS* (FEET) (PSI)		FLOW (GPM)	2" CTS HEAD LOSS* (FEET) (PSI)	
2	6.14	1.64	0.71	8.58	1.34	0.58	14.72	1.02	0.44
4	12.28	5.93	2.57	17.17	4.84	2.10	29.44	3.68	1.60
5	15.36	8.98	3.89	24.46	7.31	3.17	36.81	5.56	2.41
6	18.43	12.58	5.45	25.75	10.25	4.44	44.17	7.80	3.38
8	24.57	21.42	9.29	34.34	17.47	7.57	58.89	13.28	5.76
10	30.71	32.38	14.04	42.92	26.40	11.44	73.61	20.08	8.71
12	36.85	45.29	19.63	51.50	37.00	88.33	88.33	28.16	12.21

*Head Loss/100' of pipe


TABLE 2:
APPROXIMATE EQUIVALENT LENGTH OF PIPE (ft.)
CPVC SDR (CTS) PIPE FITTINGS

PIPE SIZE (IN)	90° ELBOW	45° ELBOW	THROUGH TEE RUN	THROUGH TEE BRANCH
½	1.6	0.8	1.0	3.1
¾	2.1	1.1	1.4	4.1
1	2.6	1.4	1.7	5.3
1¼	3.5	1.8	2.3	6.9
1½	4.0	2.1	2.7	8.1
2	5.2	2.8	3.5	10.3

TABLE 3:
MINIMUM LAYING LENGTHS OF CPVC CTS PIPE FITTINGS (in.)

NOMINAL PIPE SIZE (IN.)	ELBOW G	45° ELBOW J	TEE G	COUPLING N
½	0.382	0.183	0.382	0.102
¾	0.507	0.235	0.507	0.102
1	0.633	0.287	0.633	0.102
1¼	0.758	0.339	0.758	0.102
1½	0.884	0.391	0.884	0.102
2	1.134	0.495	1.134	0.102

**Minimum Dimensions from Center to End of Socket
(Laying Length) for CPVC 41, SDR 11 Plastic Pipe and Tubing Fittings A.B.C.**

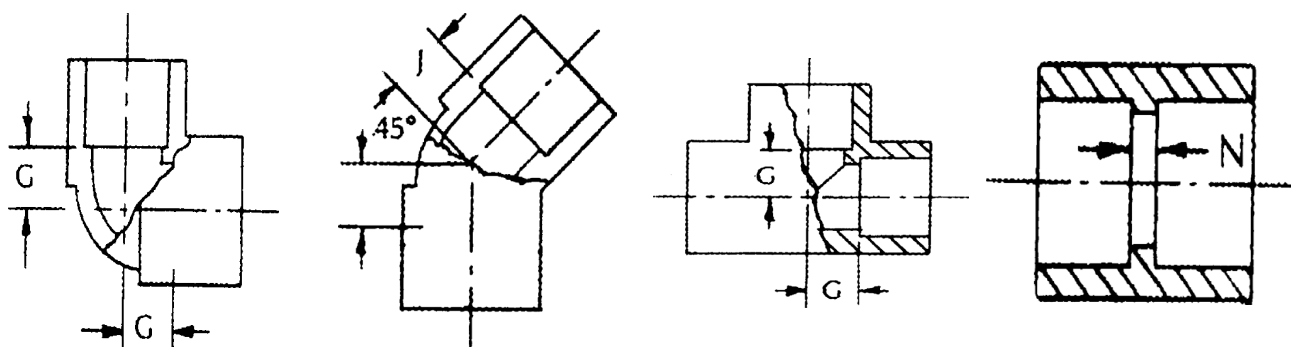

Disclaimer:

The information herein has been prepared solely from publicly available sources or from consensus positions adopted by manufacturers of these products or other interested parties in the industry. PPFA disclaims warranties, expressed or implied, as to the fitness for any particular purpose or suitability for any specific installation.