




LCRR Compliance Updates

- Laura Higgins, Manager

Presentation Outline

- Presentation Purpose
- Rule Promulgation Timeline
- Lead and Copper Rule Revision (LCRR) Requirements
- Current Processes
- Lead and Copper Rule Improvements (LCRI)
- Resources
- Q&A

Timeline of Rule Promulgation

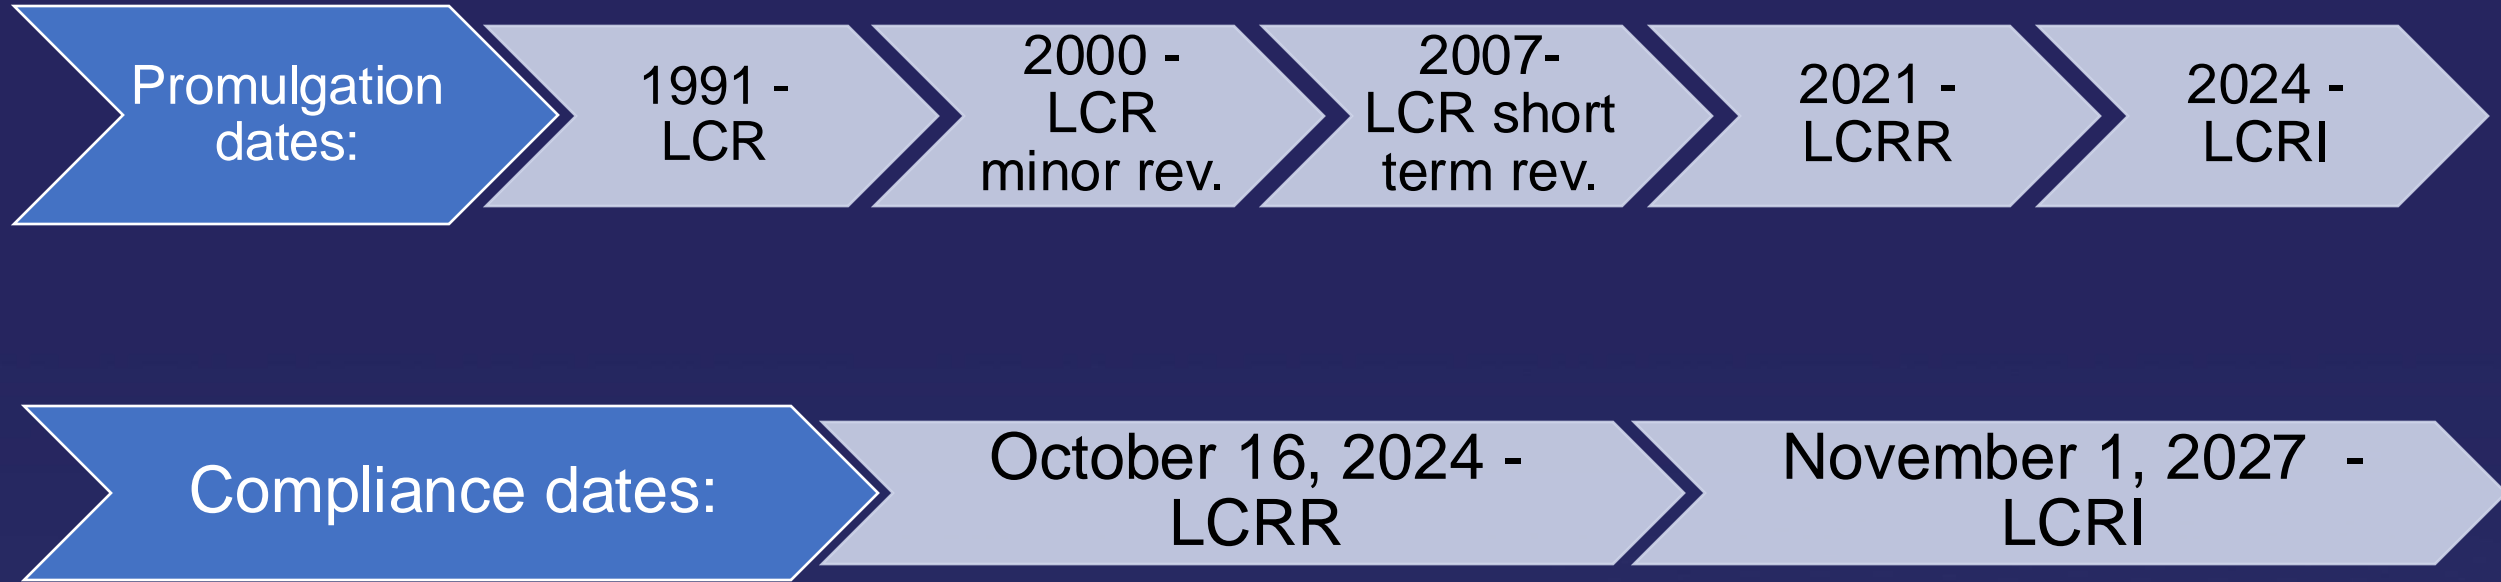

Proposed Rule → Promulgated (Finalized) Rule → (+3YRs) Compliance Date for Rule


What's new as of October 16, 2024



LCRR Requirements ⁽¹⁾

- Initial lead service line inventory - due October 16, 2024
- Public notice requirements
 - Deliver to customers with service lines other than non-lead within 30 days of inventory submission
 - Tier 1 notice (within 24-hours of a 90th percentile Lead Action Level Exceedance)
- Consumer confidence report requirements
 - Include a statement that a service line inventory has been prepared and include instructions on how to access it. If the service line inventory is available online, the report must include the direct link to the inventory.

Summary of Data as of December 31, 2024

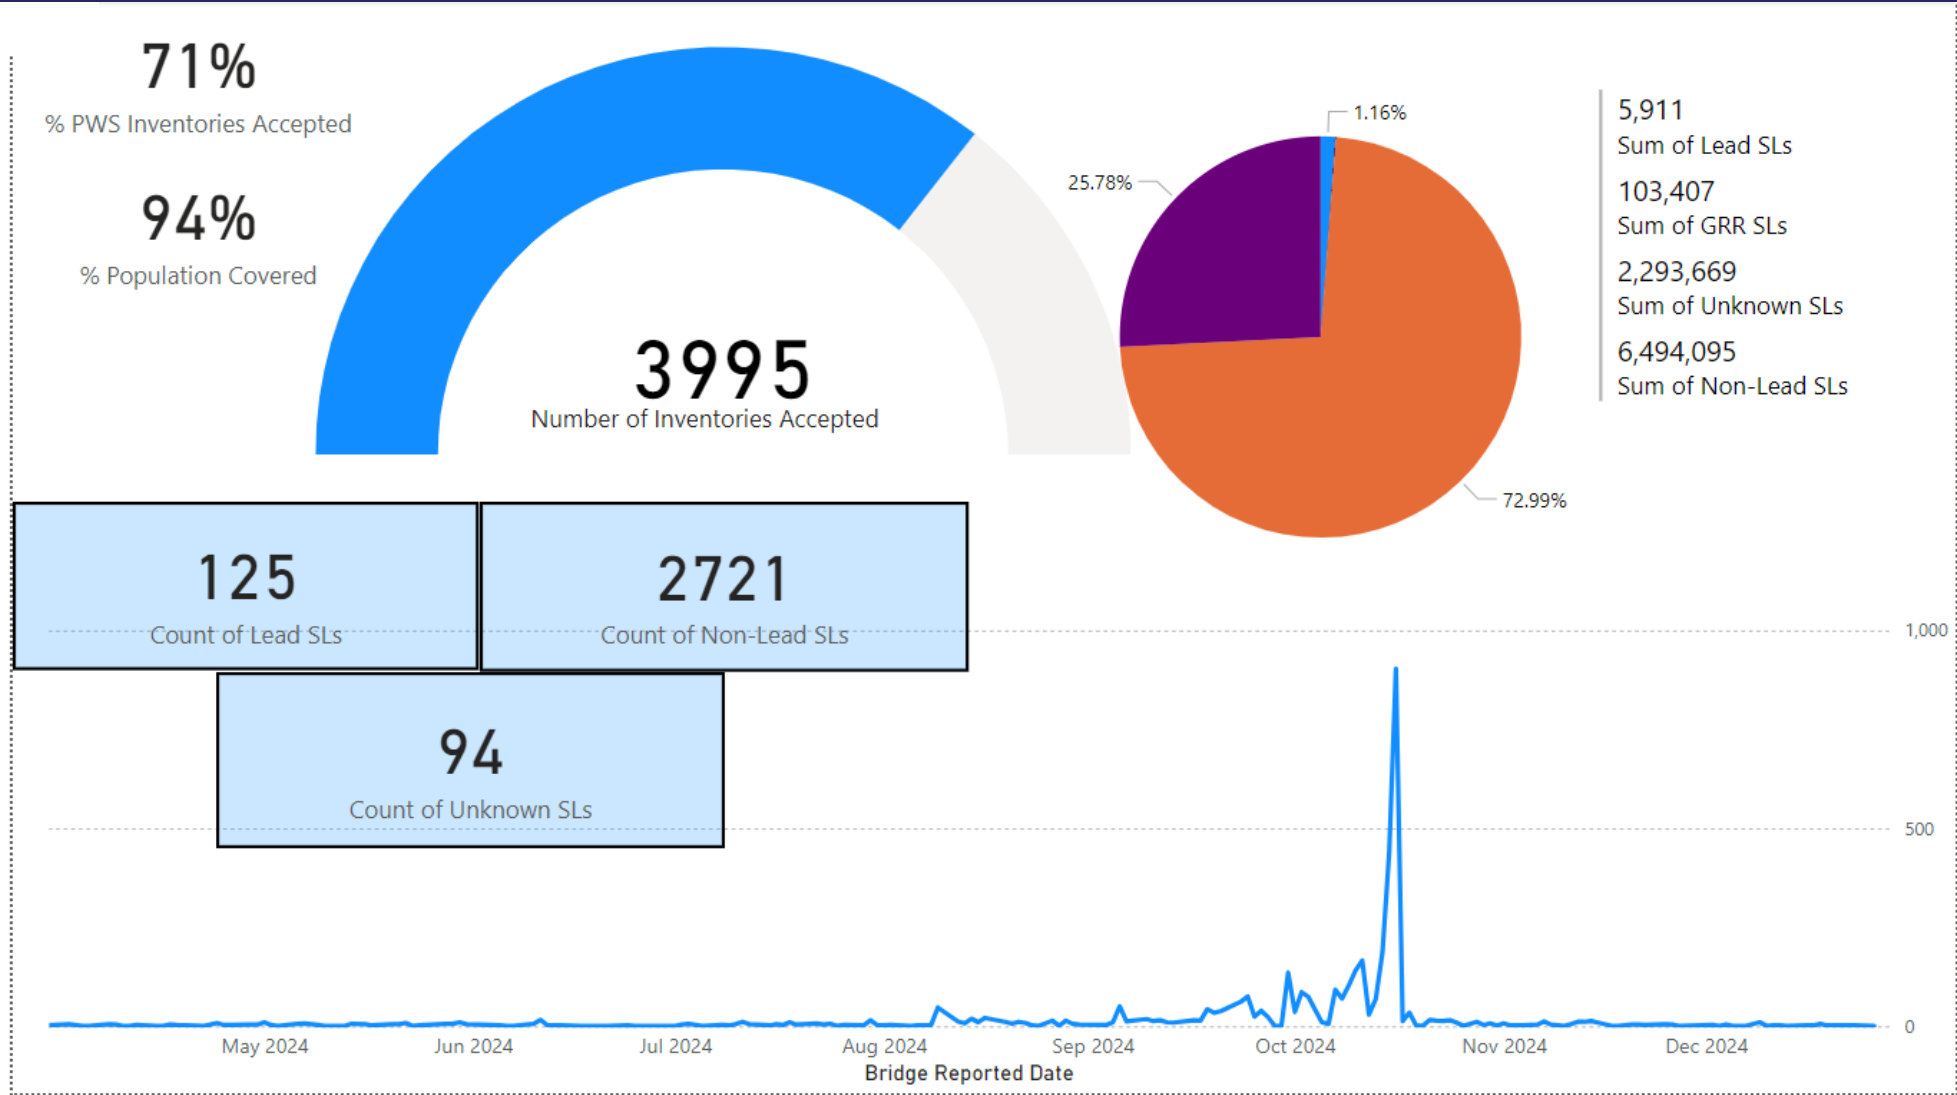

How to Submit a Service Line Inventory

- Submit via TCEQ LSLI online portal using GEC SWIFT Submittals

- Registration Link

<https://tx.gecsws.com/Account/Register?ag=TXCEQ&app=SSBMT>

- Training Video

<https://register.gotowebinar.com/recording/recordingView?webinarKey=6597528703976598357®istrationEmail=garrett.heathman%40tceq.texas.gov>

LCRR Requirements ⁽¹⁾

- Initial lead service line inventory - due October 16, 2024
- Public notice requirements
 - Deliver to customers with service lines other than non-lead within 30 days of inventory submission
 - Tier 1 notice (within 24-hours of a 90th percentile Lead Action Level Exceedance)
- Consumer confidence report requirements
 - Include a statement that a service line inventory has been prepared and include instructions on how to access it. If the service line inventory is available online, the report must include the direct link to the inventory.

What's new as of October 30, 2024



LCRI Requirements

- Baseline Inventory
- Lead Service Line Replacement
- Tiering Structure
- Sampling Changes
- Lowered Action Level for Lead
- Public Notice and Education
- Distribution System and Site Assessment
- Schools and Childcare Facility Testing

And More!!!

LCRR To LCRI Transition

What happens in the time between October 16, 2024, and the compliance date of the LCRI?

- **30 TAC § 290.117** Regulation of Lead and Copper
 - Continue to follow the current LCR rules in addition to the provisions of the LCRR previously discussed
 - 40 CFR 141.80(a)(4)

Additional Resources

- TCEQ LCRR and LCRI Webpage:
<https://www.tceq.texas.gov/drinkingwater/chemicals/lcrr>
- EPA's Lead and Copper Rule Implementation Tools:
<https://www.epa.gov/dwreginfo/lead-and-copper-rule-implementation-tools>
- EPA's Lead and Copper Rule Improvements Webpage:
<https://www.epa.gov/ground-water-and-drinking-water/lead-and-copper-rule-improvements>

Contact Information

Lead and Copper Monitoring Team

LCRR@tceq.texas.gov

Questions regarding registering for TCEQ's LSLI portal

SWIFT@tceq.texas.gov

Questions?

